


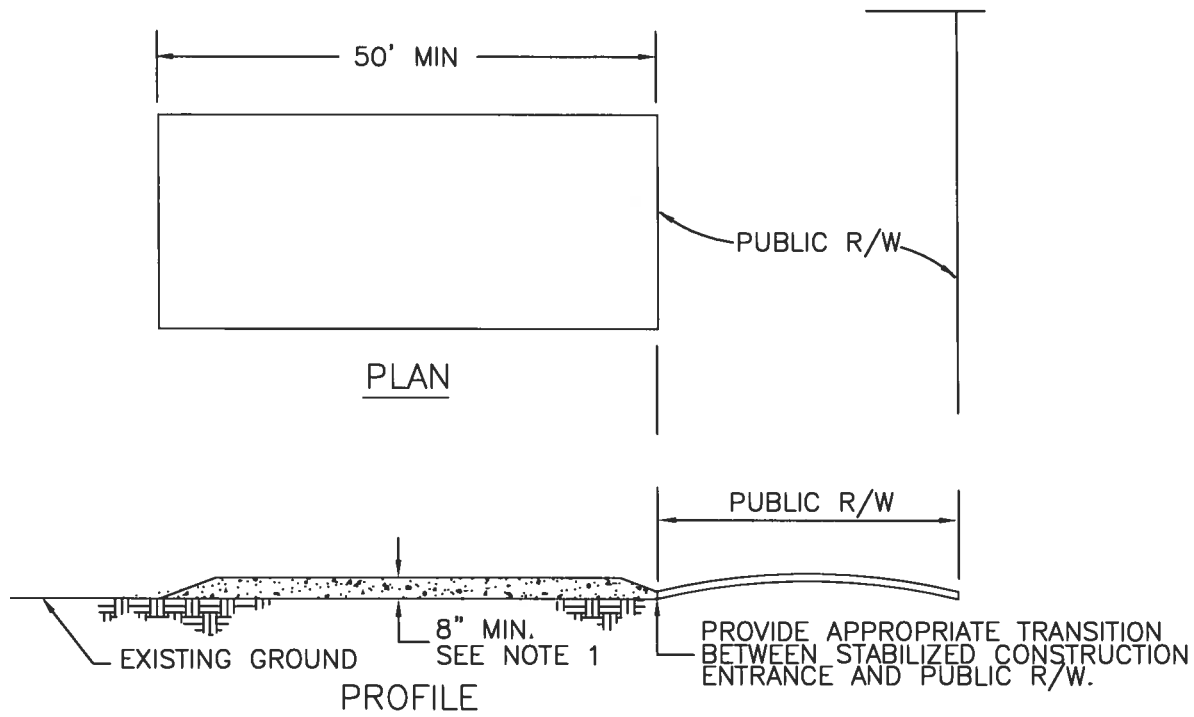

SPECIFICATION FOR TEMPORARY STABILIZED CONSTRUCTION ENTRANCE

DESIGN AND CONSTRUCTION SPECIFICATIONS

1. THE MATERIAL FOR CONSTRUCTION OF THE PAD SHALL BE 2" TO 3" STONE.
2. THE THICKNESS OF THE PAD SHALL NOT BE LESS THAN 8".
3. THE WIDTH OF THE PAD SHALL NOT BE LESS THAN THE FULL WIDTH OF ALL POINT OF INGRESS OR EGRESS.
4. THE LENGTH OF THE PAD SHALL BE AS REQUIRED, BUT NOT LESS THAN 50'.
5. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED, OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY SHALL BE REMOVED IMMEDIATELY.
6. WHEN NECESSARY, WHEEL SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHTS-OF-WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATERCOURSE THROUGH USE OF SAND BAGS, GRAVEL, BOARD OR OTHER APPROVED METHODS.

X:\Eng\14\CAD\STANDARD Details\CG-14 (Driveway/Sep/Sidewalk) Rev1.dwg



CITY OF MENLO PARK STANDARD DETAILS

STABILIZED CONSTRUCTION ENTRANCE

APPROVED

ENGINEERING SERVICES MANAGER, R.C.E. No. C64366

STD. DETAIL No. CG-16

DRAWN JO	CHECKED VP	DATE 10/31/13	SCALE NTS	SHEET 1 OF 1
-------------	---------------	------------------	--------------	-----------------