



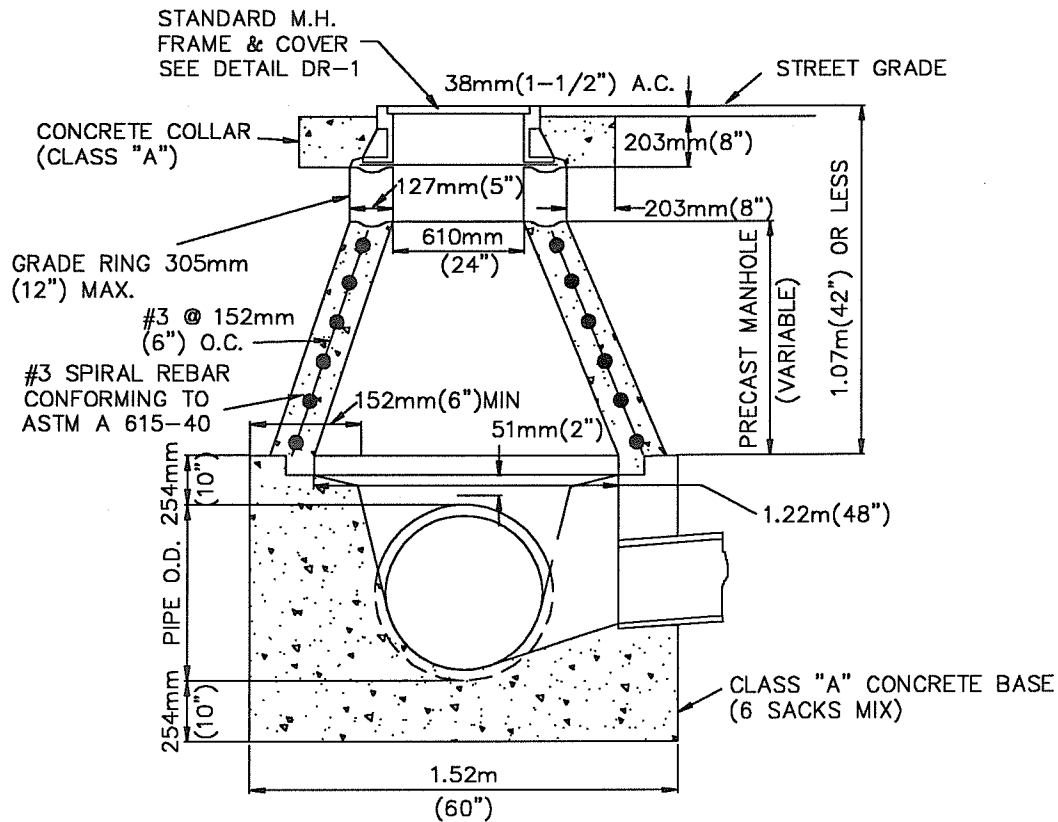

SECTION A-A

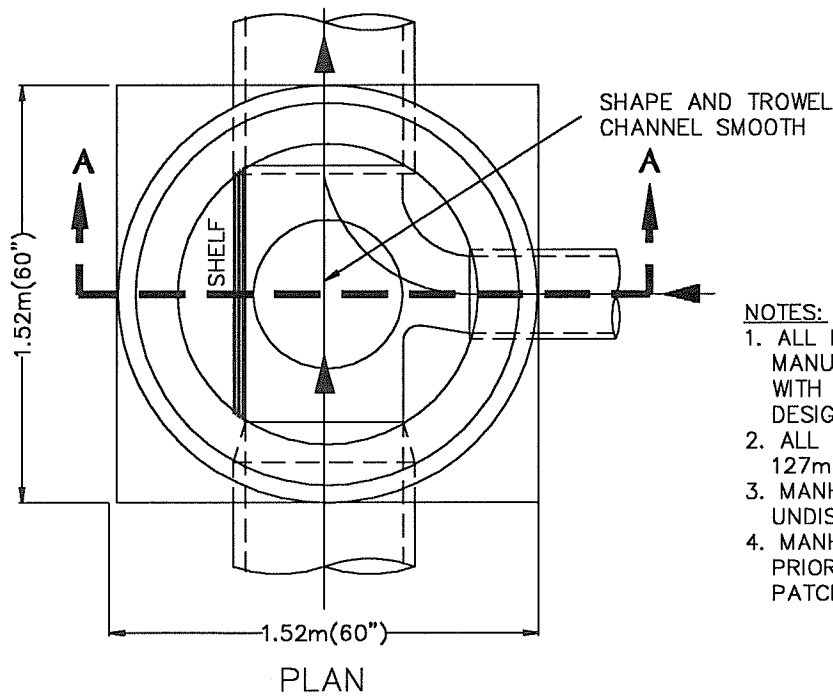

NOTES:

1. ALL PRECAST MANHOLE SECTIONS TO BE MANUFACTURED IN STRICT ACCORDANCE WITH THE LATEST PROVISIONS OF AS DESIGNATION C-478
2. ALL 1.22m(48") PRECAST SECTIONS SHALL 127mm(5") THICK WALLS
3. MANHOLE BASE TO BE POURED ON UNDISTURBED EARTH
4. MANHOLE CASTING TO BE SET TO GRADE PRIOR TO PLACING 38mm(1-1/2") A.C. PATCH

All units are in metric
Non-metric units in brackets

ACAD FILENAME: STORMAN2



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

STORM DRAIN MANHOLE
SHALLOW COVER H≤1.07m(42")
(FOR PIPES I.D. 1.07m(42") OR LESS

APPROVED
[Signature]
Director of Engineering Services R.C.E. No. 40998

DRAWN
CHECKED
NN

DATE 1-1-97

SCALE NTS

SHEET 1 OF 1

STD. DETAIL No.: **DR-3**