




REMOVE SUFFICIENT PORTION OF STORMWATER INLET
TO ALLOW FOR FORMING NEW DESK.
DO NOT CUT EXISTING REINFORCING STEEL

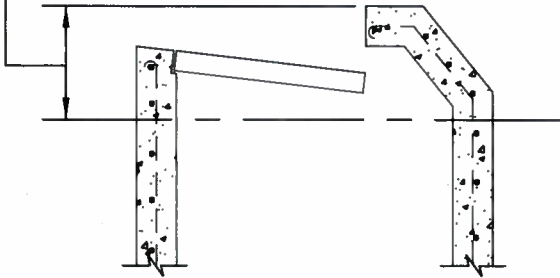

TYPICAL SECTION OF EXISTING SWI

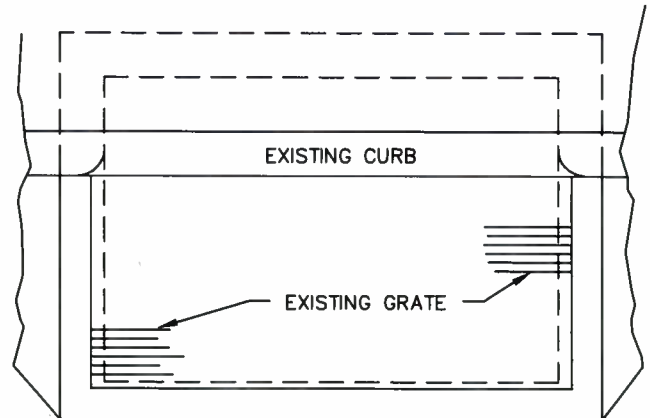


PLAN OF EXISTING SWI

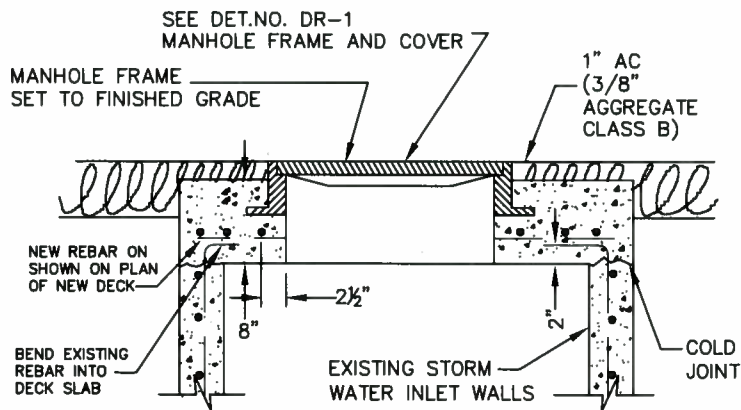

CONCRETE MIX: CLASS A (6 SACKS)
3500PSI COMPRESSIVE STRENGTH
@ 28 DAYS

TYPICAL SECTION OF NEW DECK

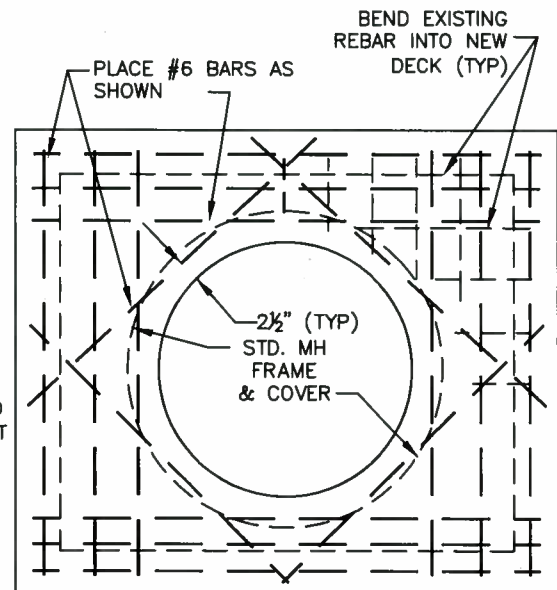

PLAN OF NEW DECK

ACAD FILENAME: SWICON



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

STORM WATER INLET
TO JUNCTION
BOX CONVERSION

APPROVED 
Senior Engineer, R.C.E. No. 65727

DRAWN AL CHECKED VP DATE 9/3/14 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: DR-6