




All units are in metric
Non-metric units are in brackets

ACAD FILENAME:ELEC000

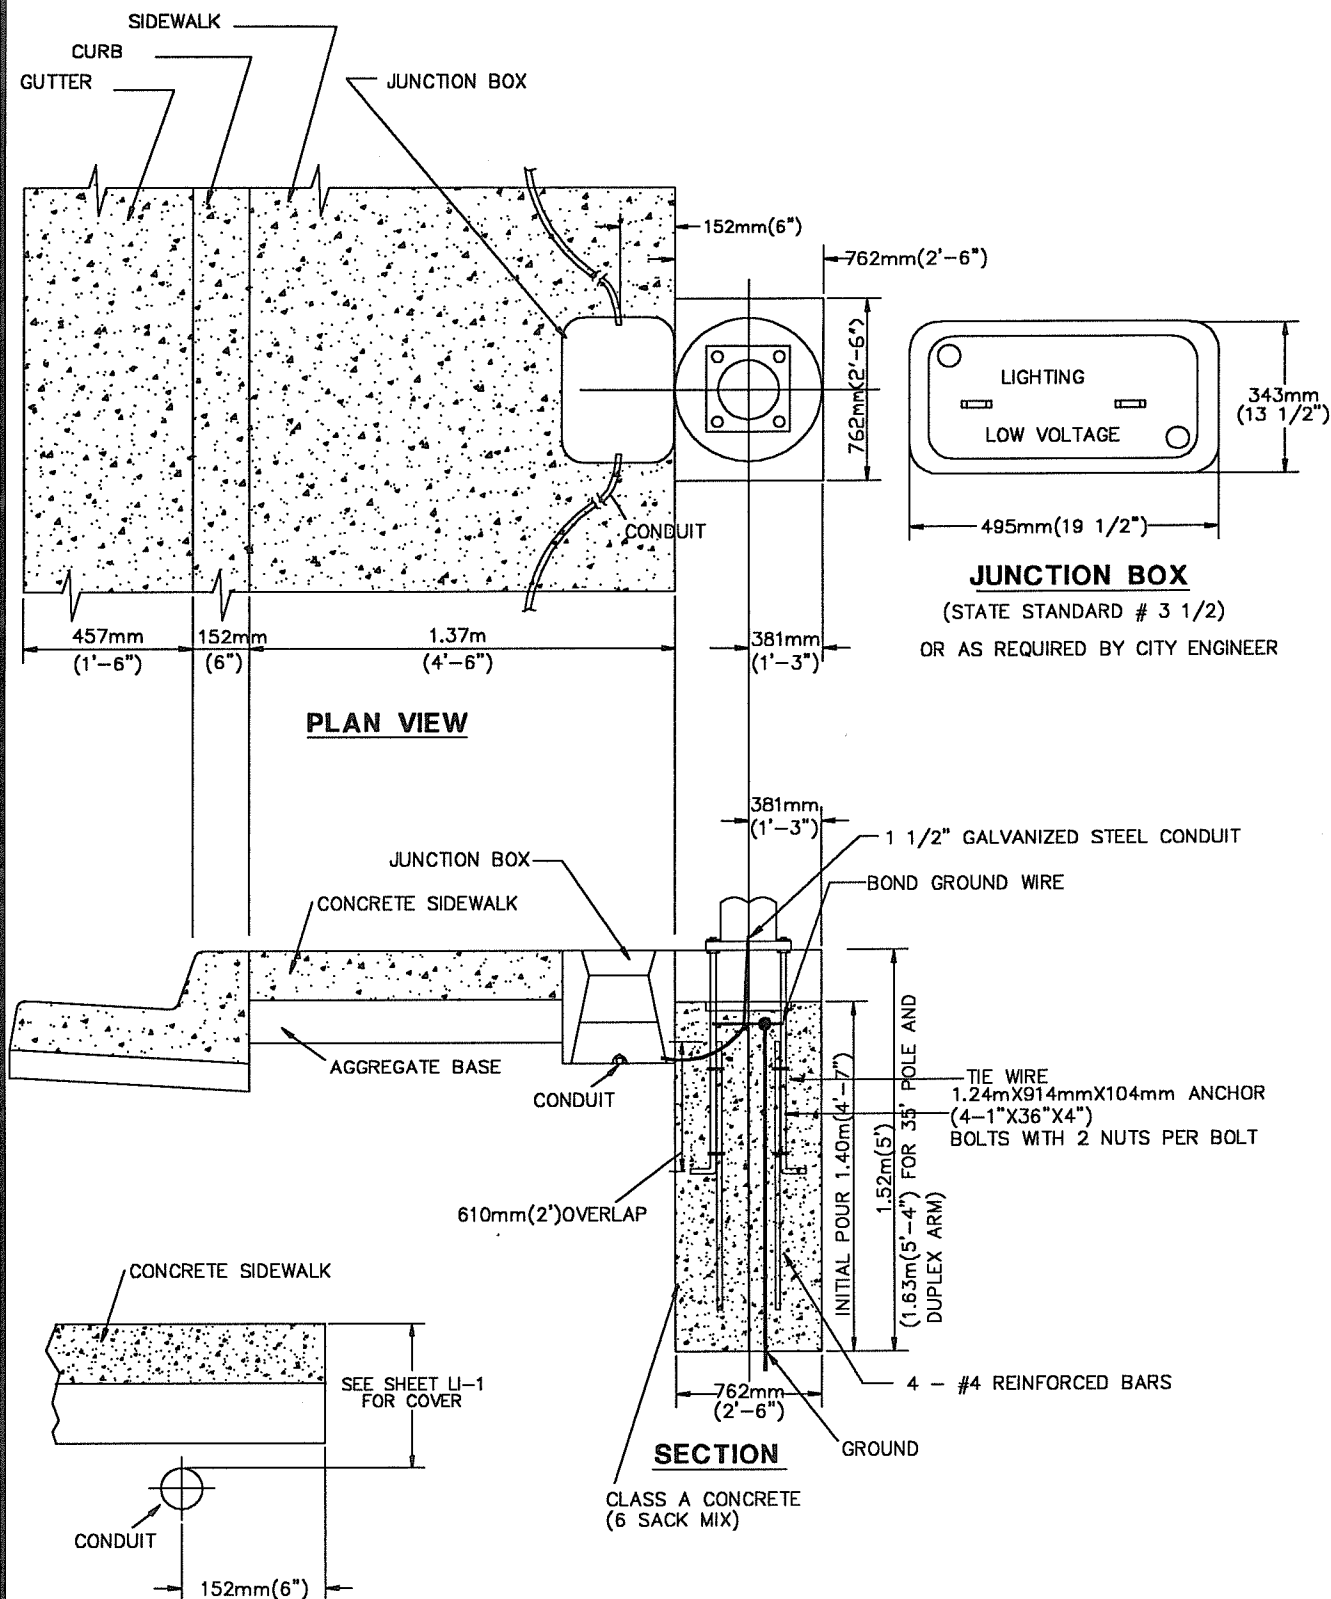

CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

**ELECTROLIER AND
CONDUIT LOCATION
(FOR MONOLITHIC SIDEWALK)**

APPROVED
Y. A. Chmura
Director of Engineering Services R.C.E. No. 40998

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: **LI-2**