


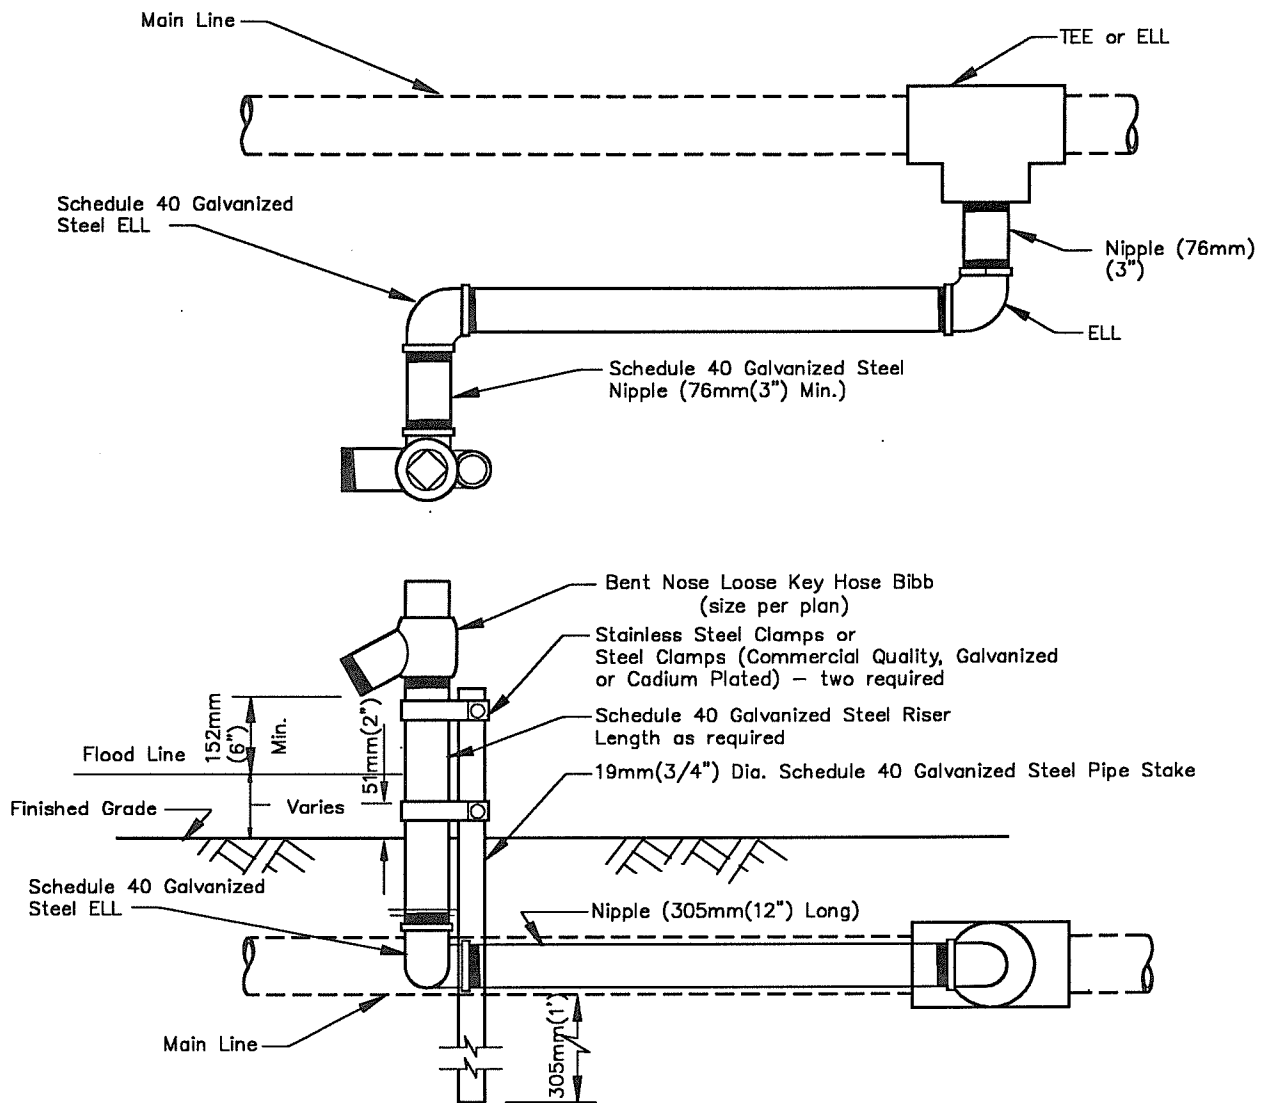

NOTES:

1. All Pipe and fittings shall be Schedule 80 PVC unless otherwise specified.
2. Pipe size from Main Line shall match Hose Bibb inlet Diameter.
3. Dissimilar metals shall be separated by an approved Dielectric Coupling.
4. Plastic Pipe shall not be used above finished grade.
5. Use Teflon compound on threaded joints.

All units are in metric
Non-metric units are in brackets

ACAD FILENAME: BIBBVALV



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

IRRIGATION SYSTEM HOSE BIBB VALVE (BELOW GRADE)

APPROVED

for *Yan A. Chan*
Director of Engineering Services R.C.E. No.40998

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: **LS-10**