
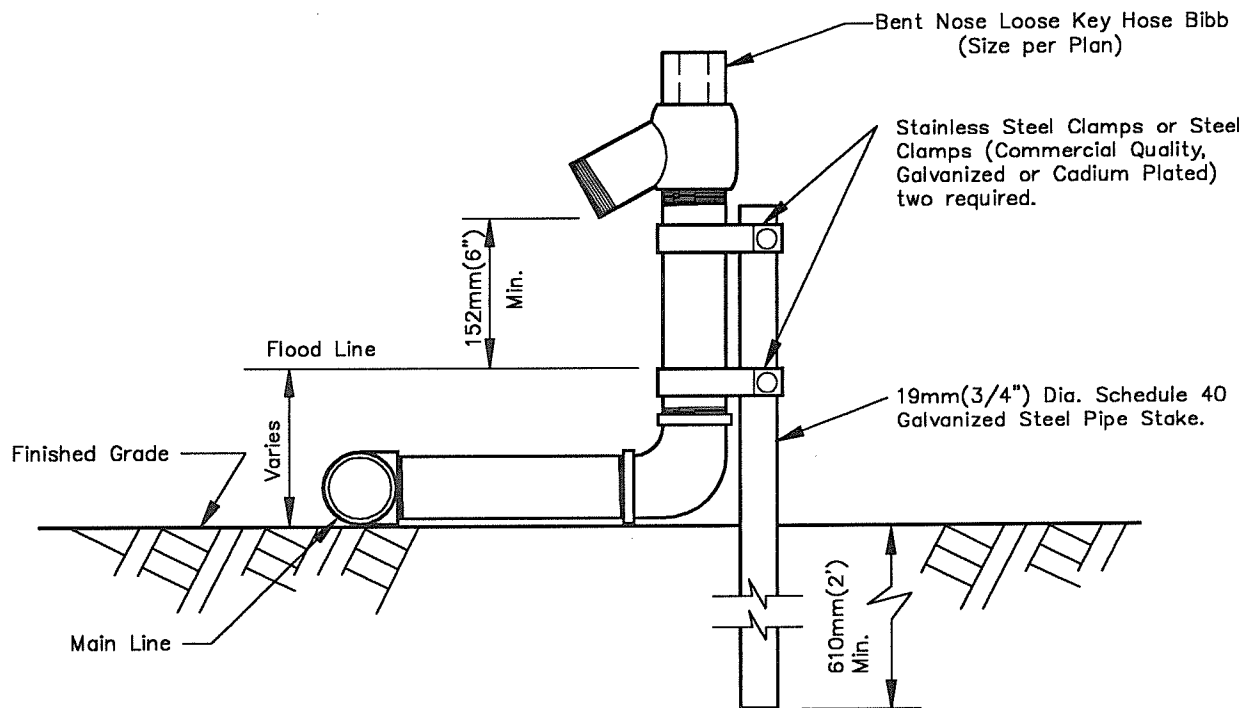


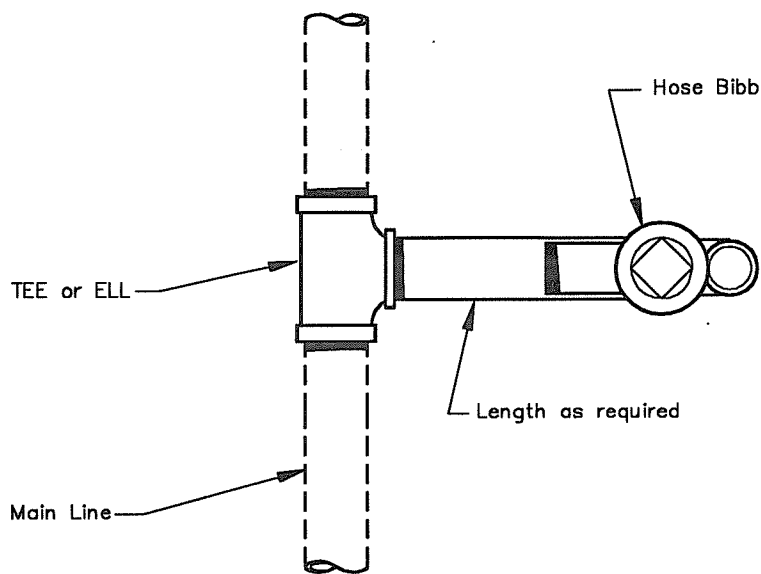

NOTES:

1. All Pipe and Fittings shall be Schedule 40 Galvanized Steel unless otherwise specified.
2. Pipe size from Main Line shall match Hose Bibb inlet diameter.
3. Plastic Pipe shall not be used above finished grade.
4. Use Teflon compound on threaded joints.

All units are in metric
Non-metric units are in brackets

ACAD FILENAME: BIBBVALV2



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

IRRIGATION SYSTEM HOSE BIBB VALVE (ABOVE GRADE)

APPROVED

[Signature]
Director of Engineering Services R.C.E. No. 40998

DRAWN

CHECKED

NN

DATE 1-1-97

SCALE

NTS

SHEET 1 OF 1

STD. DETAIL No.: **LS-11**