


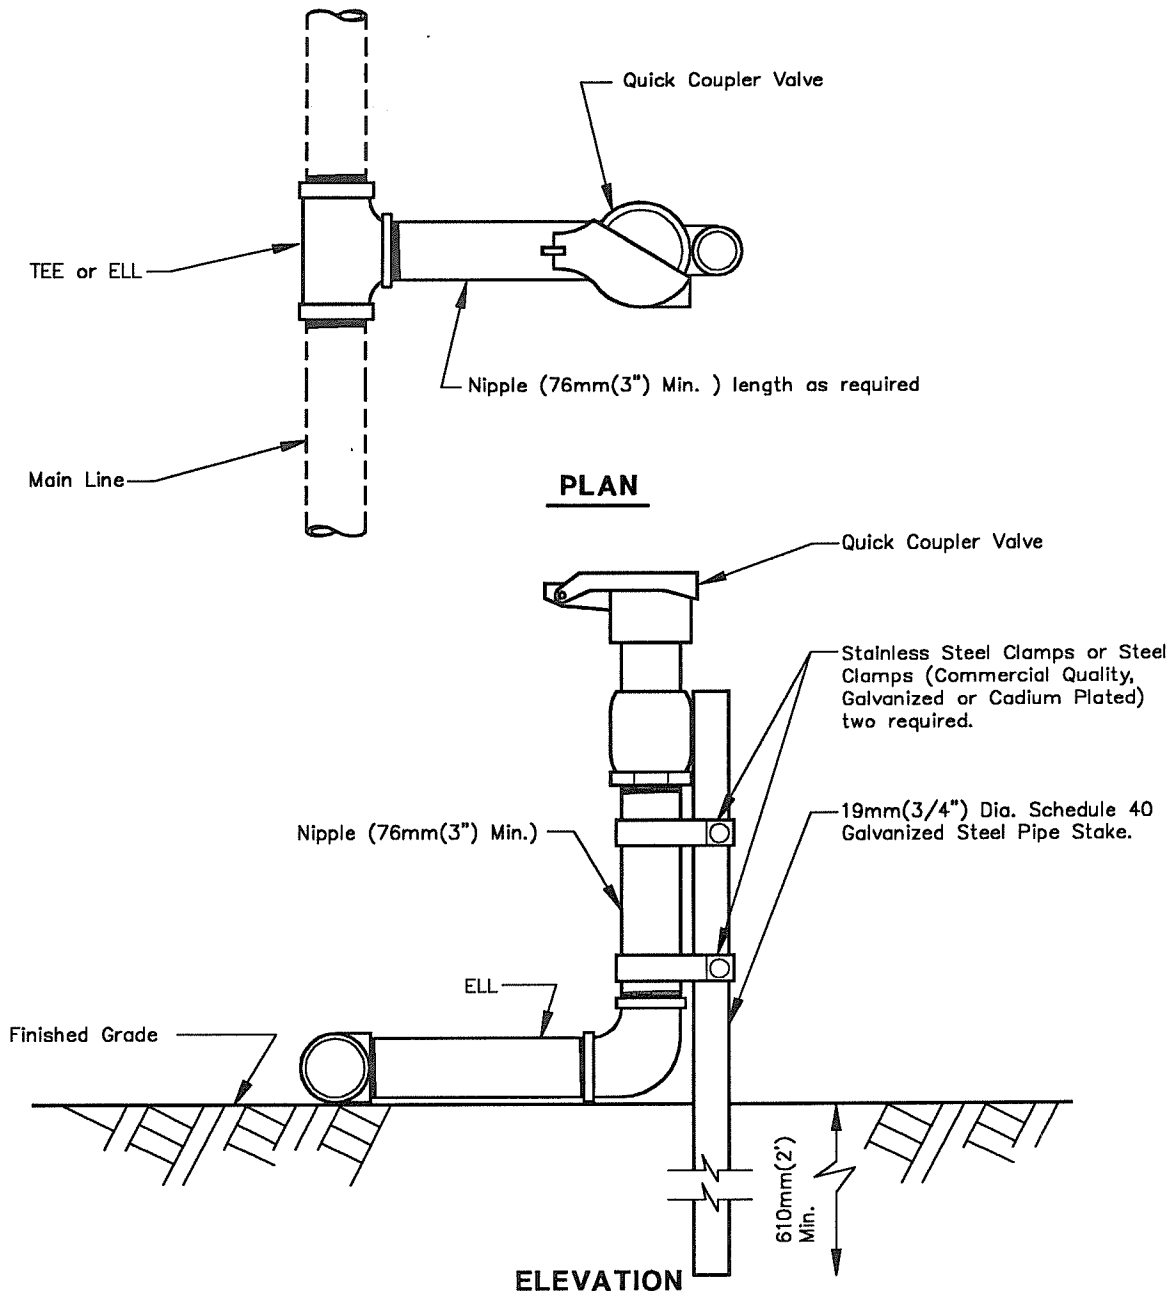

NOTES:

1. All Pipe and Fittings shall be Schedule 40 Galvanized Steel unless otherwise specified.
2. Quick Coupler Valve shall be set 254mm(10") above finished grade.
3. Pipe size from main line shall match Quick Coupler inlet diameter.
4. Dissimilar metals shall be separated by an approved Dielectric Coupling.
5. Plastic Pipe shall not be used above finished grade.
6. See detail No. LS-12 for underground quick coupler valve
7. Use Teflon compound on threaded joints.

**All units are in metric
Non-metric units are in brackets**

ACAD FILENAME: QUICVALV



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

**IRRIGATION SYSTEM
QUICK COUPLER VALVE
(ABOVE GRADE)**

APPROVED *for Y. A. O...*
Director of Engineering Services R.C.E. No.40098

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: **LS-13**