


NOTES:


1. All irrigation lines shall pass pressure test prior to backfill.

(a). Mains: 2 hours @ 9 kg/sq.cm.(125 psi)

(b). Laterals: 2 hours @ 4 kg/sq.cm(60 psi)

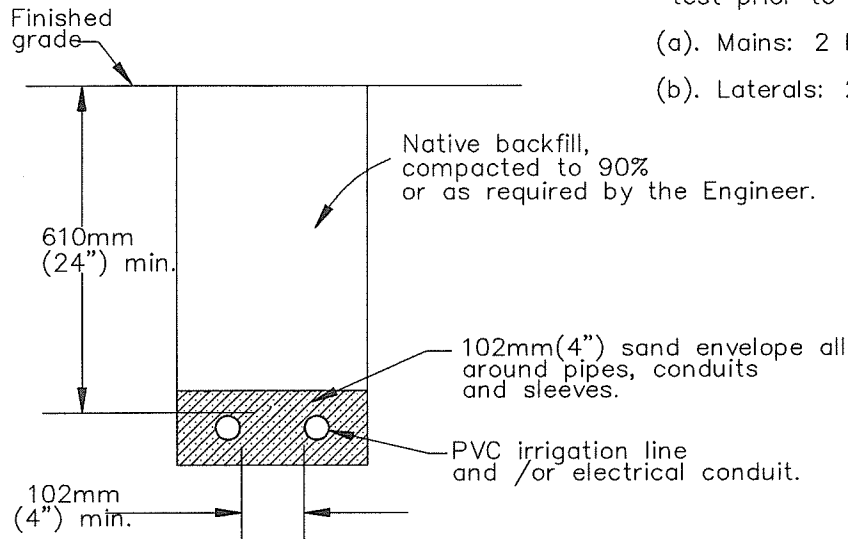

TRENCH DETAIL IN LANDSCAPE AREAS

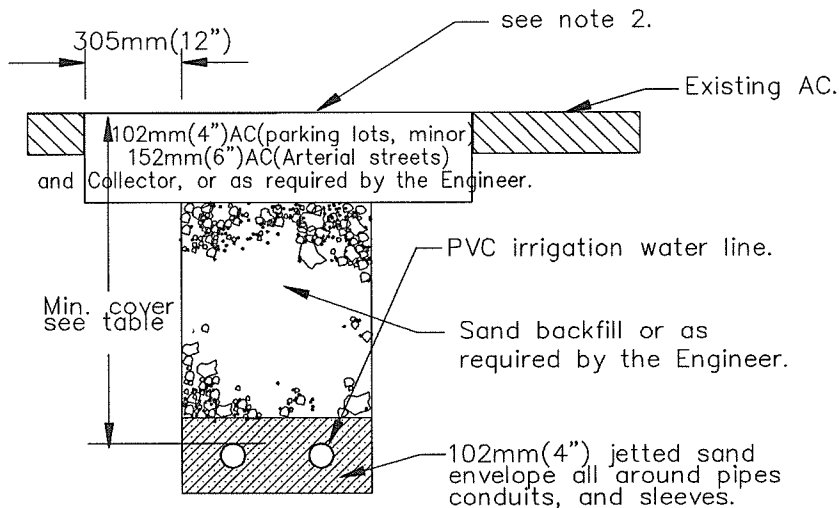

Minimum Cover	
Non pressurized lines in landscaping.	457mm (18")
Landscape, sidewalks, parking lots.	610mm (24")
Minor & Collector streets.	914mm (36")
Arterial streets	1.07m (42")

TRENCH DETAIL UNDER ASPHALT

Place conduits and lines in PVC sleeve when indicated on plans

All units are in metric
Non-metric units are in brackets
ACAD FILENAME: IRRITREN



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

**IRRIGATION SYSTEM
TRENCH DETAILS**

APPROVED

Y. A. Owen
Director of Engineering Services R.C.E. No.40998

DRAWN	CHECKED	NN	DATE	1-1-97	SCALE	NTS	SHEET	1 OF 1
-------	---------	----	------	--------	-------	-----	-------	--------

STD. DETAIL No.: **LS-3**