


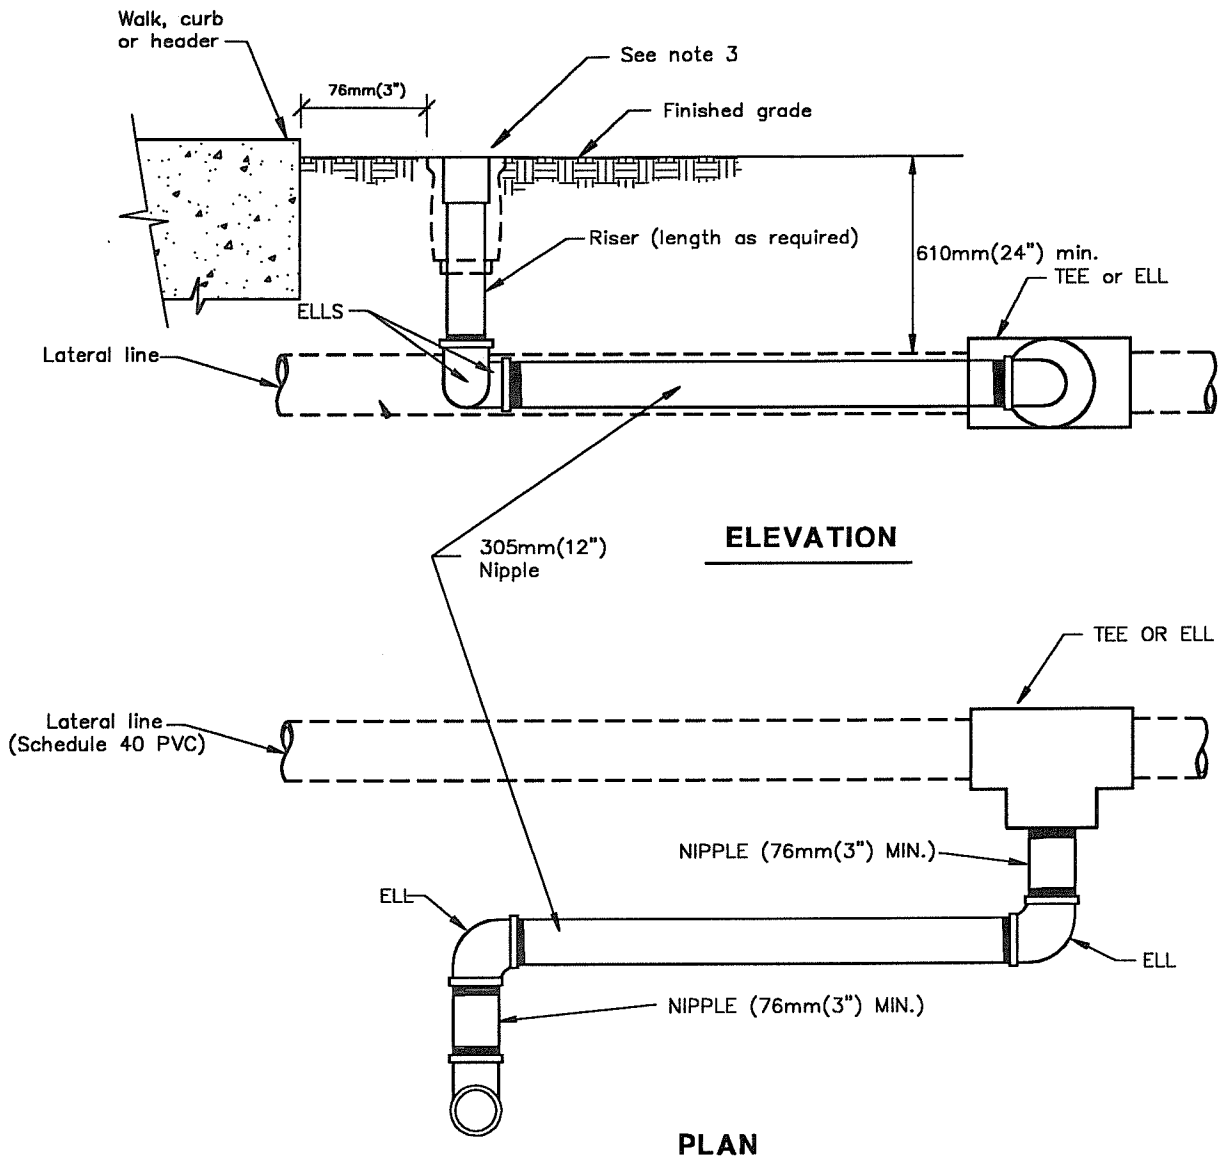

SWING JOINT DETAIL FOR SPRINKLER INSTALLATION

- NOTE:**
1. All threaded pipe and fittings shall be schedule 80 PVC.
 2. Sprinkler heads shall be as specified on plans or as approved by City Engineer prior to installation.
 3. Top of sprinkler head shall match finished grade.
 4. Approved teflon based compound shall be used on all threaded connections. No teflon tape shall be used.
 5. See Irrigation Trench Det.No. LS-3

All units are in metric
Non-metric units are in brackets

ACAD FILENAME: IRRHEAD



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

IRRIGATION SYSTEM SPRINKLER HEAD INSTALLATION

APPROVED

for *Yas A. Owens*
Director of Engineering Services R.C.E. No.40998

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: LS-4