


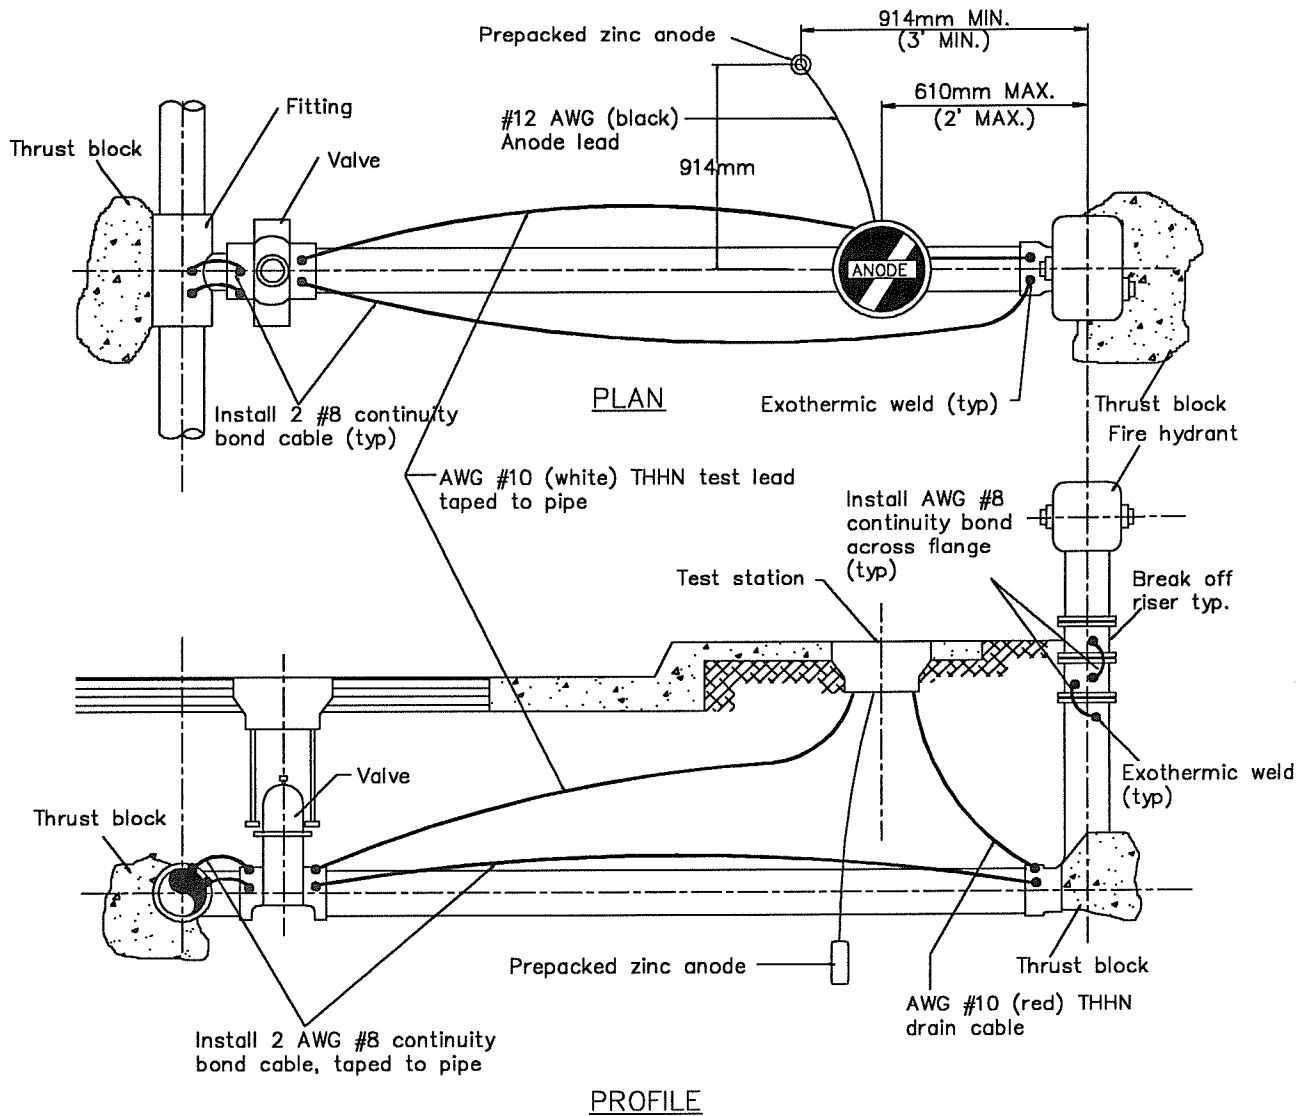

NOTES:

1. Contractor shall follow the listed wire schedule: Fitting test lead - AWG #10 White; Anode test lead - AWG #12 black; Hydrant drain cable - AWG #10 red.
2. For anode size and construction requirements, see sheet WA-12

All units are in metric
Non metric units in brackets

ACAD FILENAME/CATHYD



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

**CATHODIC PROTECTION FOR
FIRE HYDRANT**

APPROVED

Y. A. Quinn
Director of Engineering Services R.C.E. No. 40998

DRAWN

CHECKED

NN

DATE 1-1-97

SCALE

NTS

SHEET 1 OF 1

STD. DETAIL No.: **WA-11**