




NOTES:

1. ALL INSTALLATIONS SHALL COMPLY WITH CA WATER WORKS STANDARDS (CA CODE OF REGULATIONS TITLE 22, CH 16, §4555 TO §4578).
2. ALL INSTALLATIONS SHALL COMPLY WITH CA HEALTH AND SAFETY CODE.
3. ALL BENDS SHALL BE 1.14m (45"). FITTINGS ARE REQUIRED FOR PROPER HORIZONTAL SEPARATION.
4. SEPARATE THRUST BLOCKS SHALL BE USED FOR EACH BEND.
5. ADDITIONAL THRUST REQUIREMENTS MAY BE REQUIRED BY THE ENGINEER.
6. LESS THAN MINIMUM COVER, SEE DETAIL WA-18.

All units are in metric
Non-metric units are in brackets
ACAD FILENAME/FILENAME

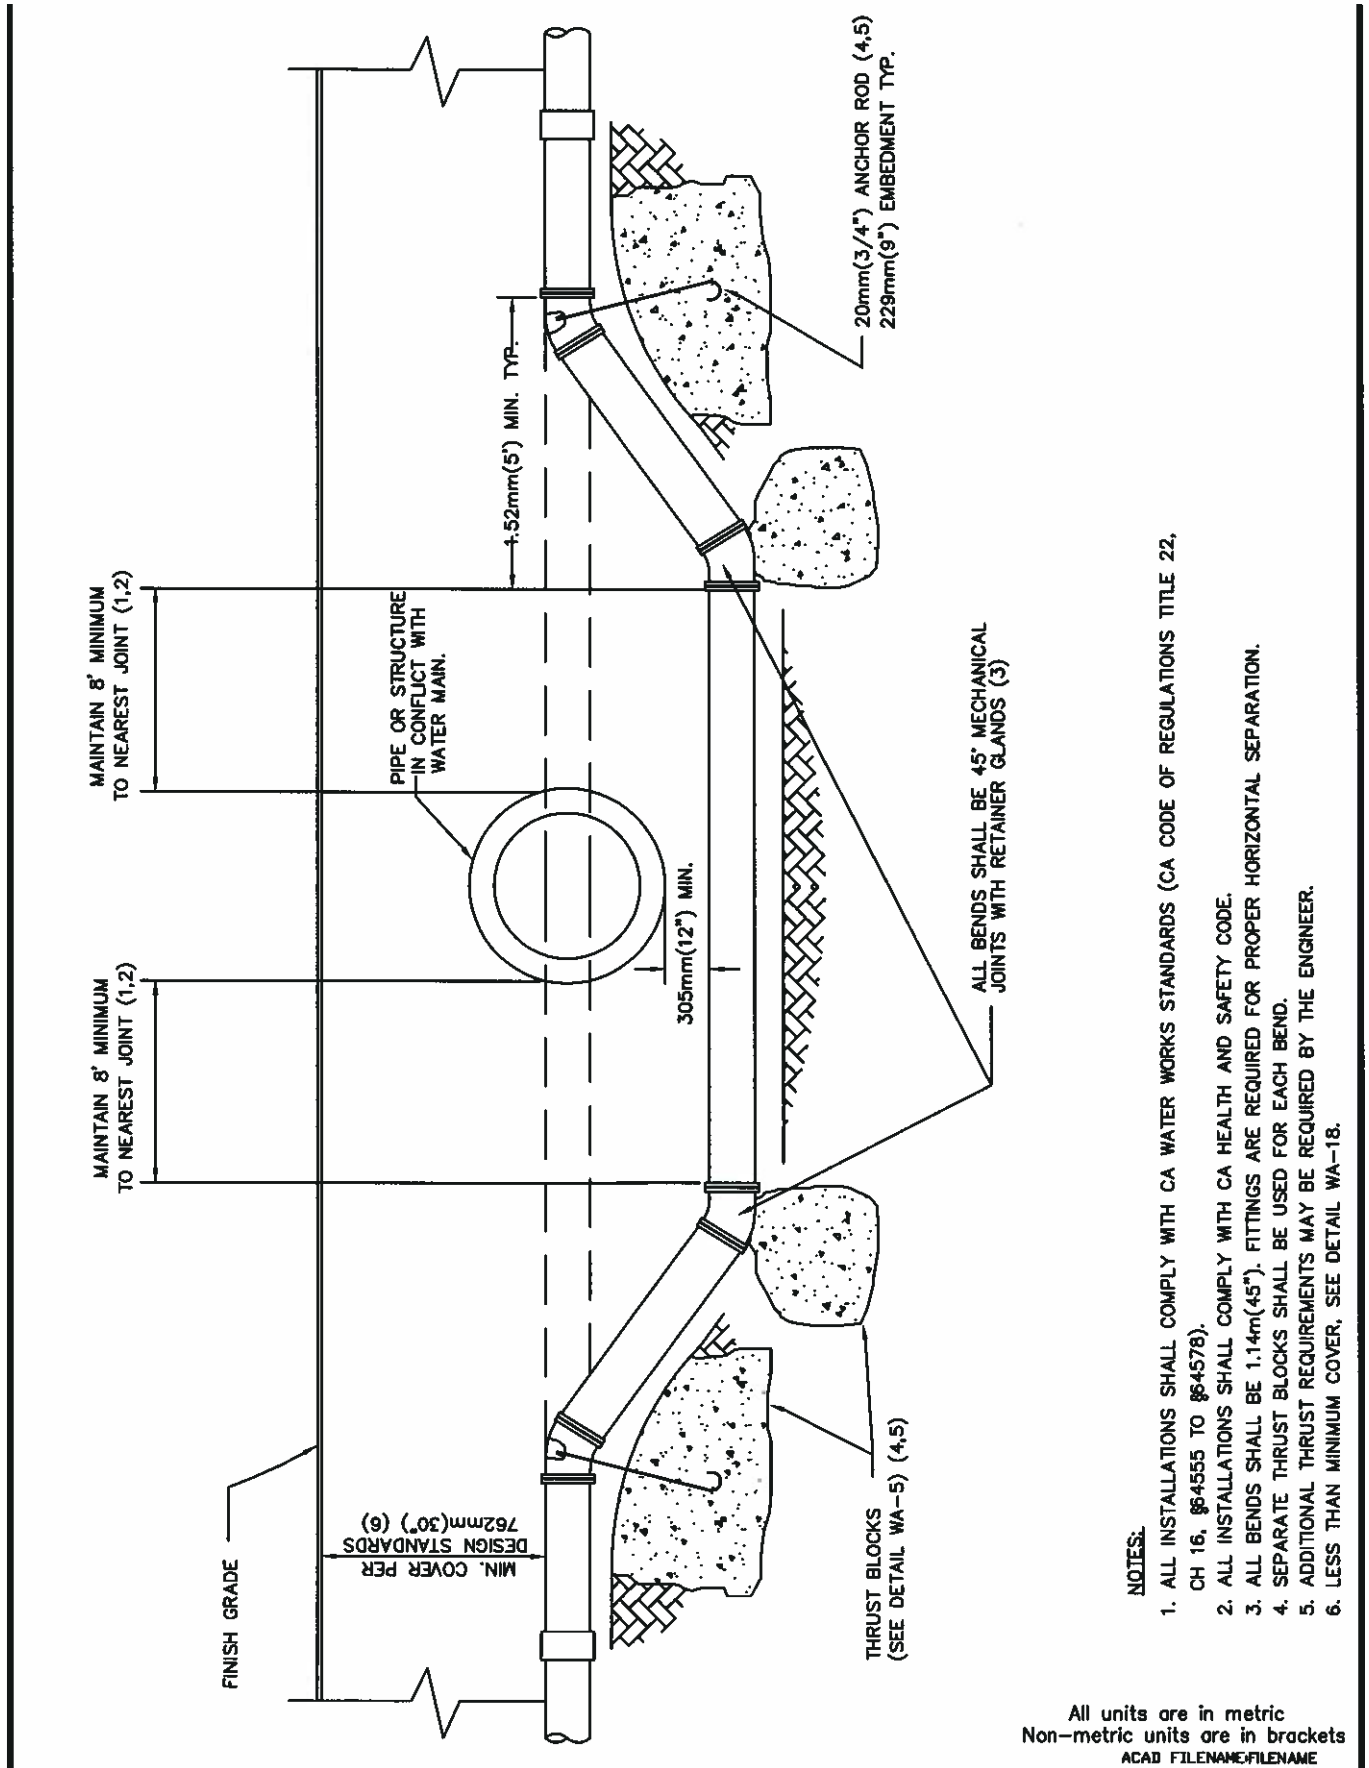

CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE
1	NOTES/DIM	3/13/08

WATER MAIN LOWERING DETAIL

APPROVED

DRAWN JEF CHECKED NN DATE 3/31/08 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: WA-15