



CITY OF MENLO PARK STANDARD DETAILS

$\frac{3}{4}$ ", 1", 1 $\frac{1}{2}$ ", AND 2"
STANDARD WATER SERVICE


APPROVED

ENGINEERING SERVICES MANAGER, R.C.E. No.70736

STD. DETAIL No. WA-17

WATER METER SIZE	BOX SIZE * CHRISTY/LID
5/8"	B9 / B9D
1"	B16 /B16E
1 1/2"	B30 /B30E
2"	B30 /B30E

*** OR APPROVED EQUAL**

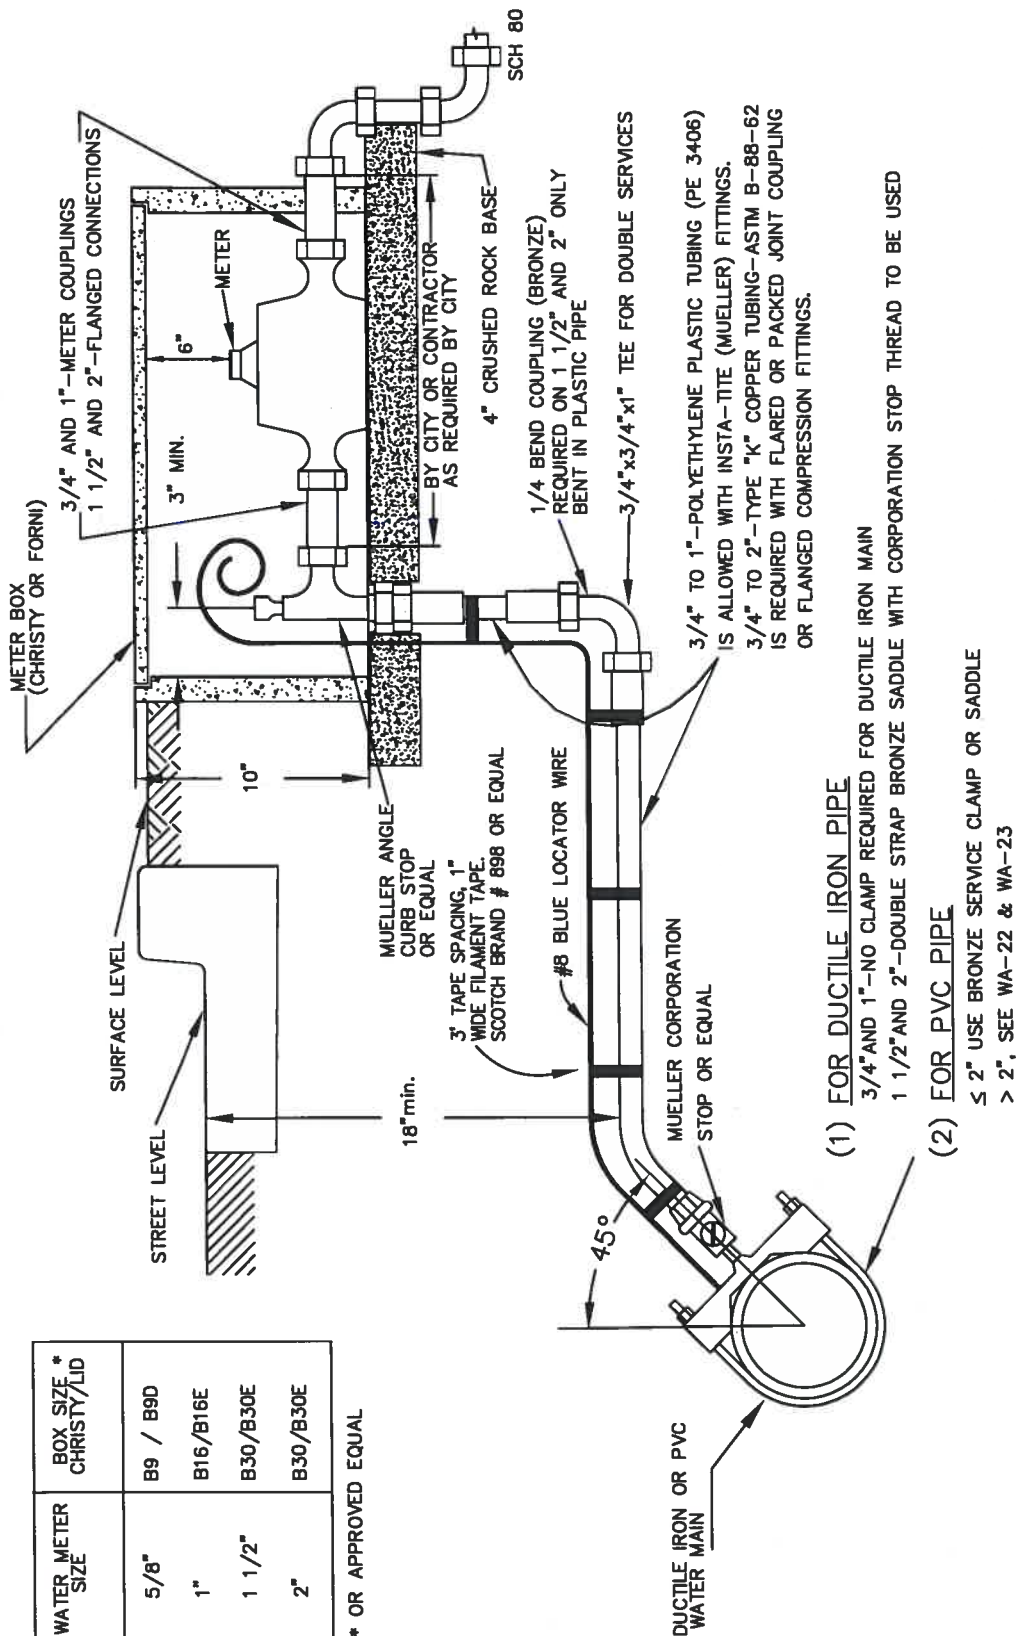

NOTES:

1. ALL SERVICES TO BE WET TAP.
2. #8 BLUE LOCATOR WIRE. USE A SINGLE LENGTH OF WIRE WITH INSULATION INTACT. COAT AT END OF WIRE WITH SCOTCHCOTE ELECTRICAL COATING OR EQUAL.
3. METER DIALS TO BE 6" FROM TOP OF BOX.
4. ALL METERS TO BE CENTERED IN BOX VERTICALLY AND HORIZONTALLY. METER STOPS TO BE READILY ACCESSIBLE.
5. NO COMPRESSION FITTINGS TO BE USED WITHOUT APPROVAL OF WATER DEPARTMENT.
6. NO DAMAGED METER BOXES SHALL BE INSTALLED (NO BROKEN ENDS TO ACCOMMODATE METERS.)
7. ABANDONMENT OF DIRECT TAP ON AC MAIN REQUIRES RUBBER LINED, STAINLESS STEEL, FULL CIRCLE CLAMP.
8. ABANDONMENT OF BRASS SADDLE TAP ON AC OR DIP MAIN IS ALLOWED BY CLOSING CORP STOP.