
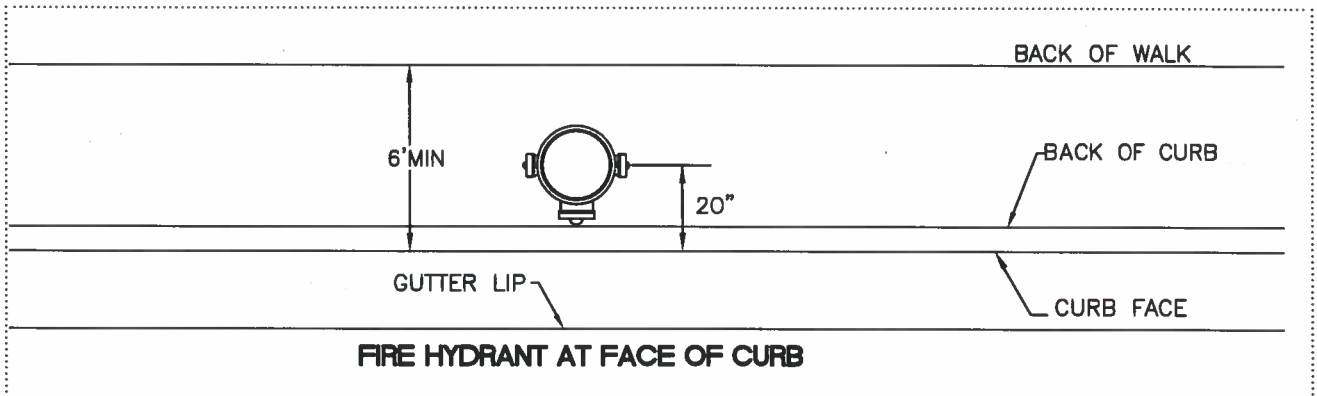


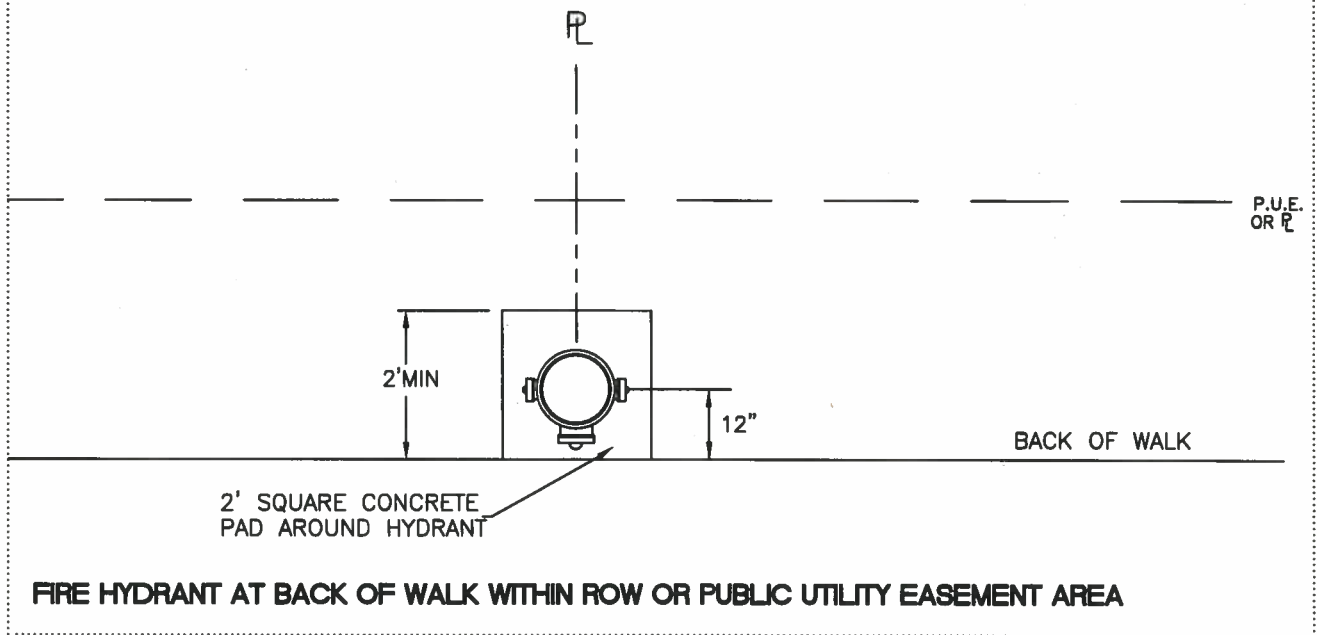

LOCATION NOTES:

1. DO NOT INSTALL STREET LIGHT OR TREE AT THE SAME PROPERTY LINE JUNCTION AS FIRE HYDRANT.
2. THE 4.5" NOZZLE SHALL BE POINTED TOWARD THE STREET.
3. REFER TO WA-1 FOR FIRE HYDRANT INSTALLATIONS.

SLAB NOTES:

1. CONCRETE PAD SHALL BE 4" THICK, MINIMUM 2'X2', CLASS A CONCRETE ON 4" CLASS 2 AGGREGATE BASE, SEE DETAIL G-3, FOR MIX DESIGN AND PLACEMENT.
2. ENGINEERING SERVICES MANAGER MAY DELETE SLAB REQUIREMENT.

X:\EngDiv\CADSTNDR\Standard Details\WA-2 FIREHYD



CITY OF MENLO PARK STANDARD DETAILS

FIRE HYDRANT LOCATION

APPROVED

Mathew Blum
ENGINEERING SERVICES MANAGER, R.C.E. No.70736

STD. DETAIL No. WA-2

DRAWN EJE	CHECKED VP	DATE 2/14/12	SCALE NTS	SHEET 1 OF 1
--------------	---------------	-----------------	--------------	-----------------