



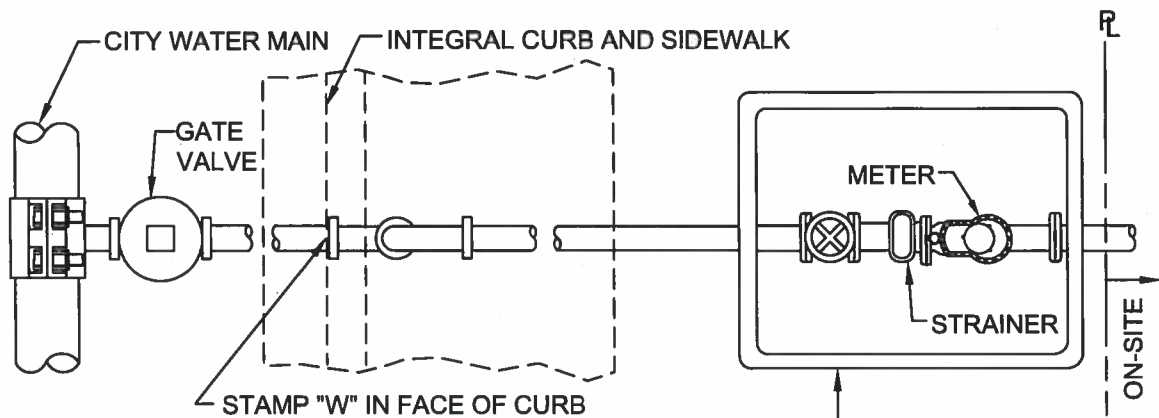

PLAN VIEW

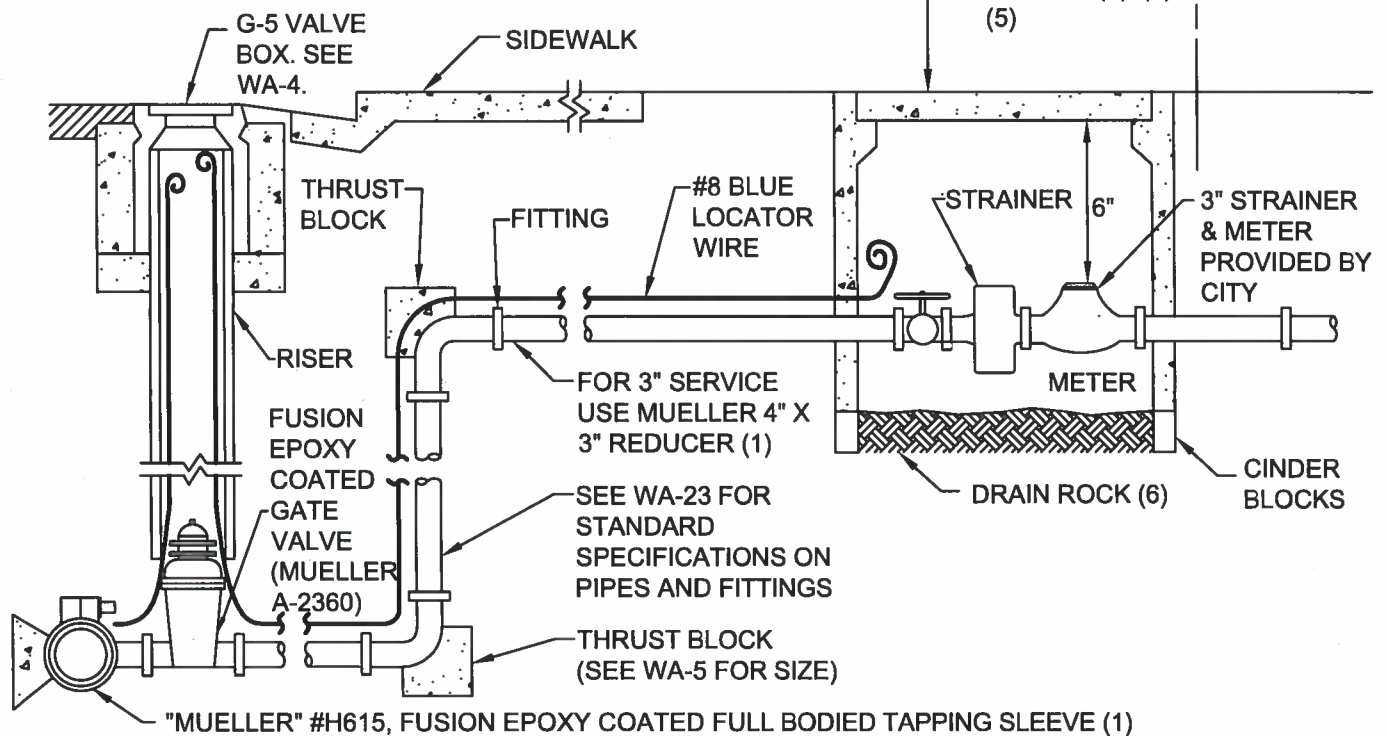

ELEVATION VIEW

NOTES:

1. FOR 3" METER, TAP MAIN WITH 4" TAP THEN USE MUELLER 4" X 3" REDUCER BEFORE METER BOX.
2. BACKFLOW PREVENTOR REQUIRED IMMEDIATELY DOWNSTREAM OF METER. SEE DETAIL WA-24.
3. METER SHALL BE IN PUBLIC RIGHT-OF-WAY, EASILY ACCESSIBLE TO METER READER, AND NOT BEHIND LANDSCAPING OR OTHER OBSTRUCTIONS.
4. THE METER AND METER BOX MAY BE ROTATED 90° TO COMPENSATE FOR SPACE REQUIREMENTS.
5. FOR 4" TURBINE METER WITH STRAINER USE BOX SIZE B-40 OR LARGER WITH METER READING LID.

CITY OF MENLO PARK STANDARD DETAILS



NO.	REVISIONS	DATE
1	NOTES	7/14/11
2		
3		
4		
5		

**3' AND 4'
STANDARD WATER SERVICE**

APPROVED

Matthew J. Brown
ENGINEERING SERVICES MANAGER, R.C.E. No.70736

STD. DETAIL No. WA-22

DRAWN EJE CHECKED VP DATE 2/14/12 SCALE NTS SHEET 1 OF 1