
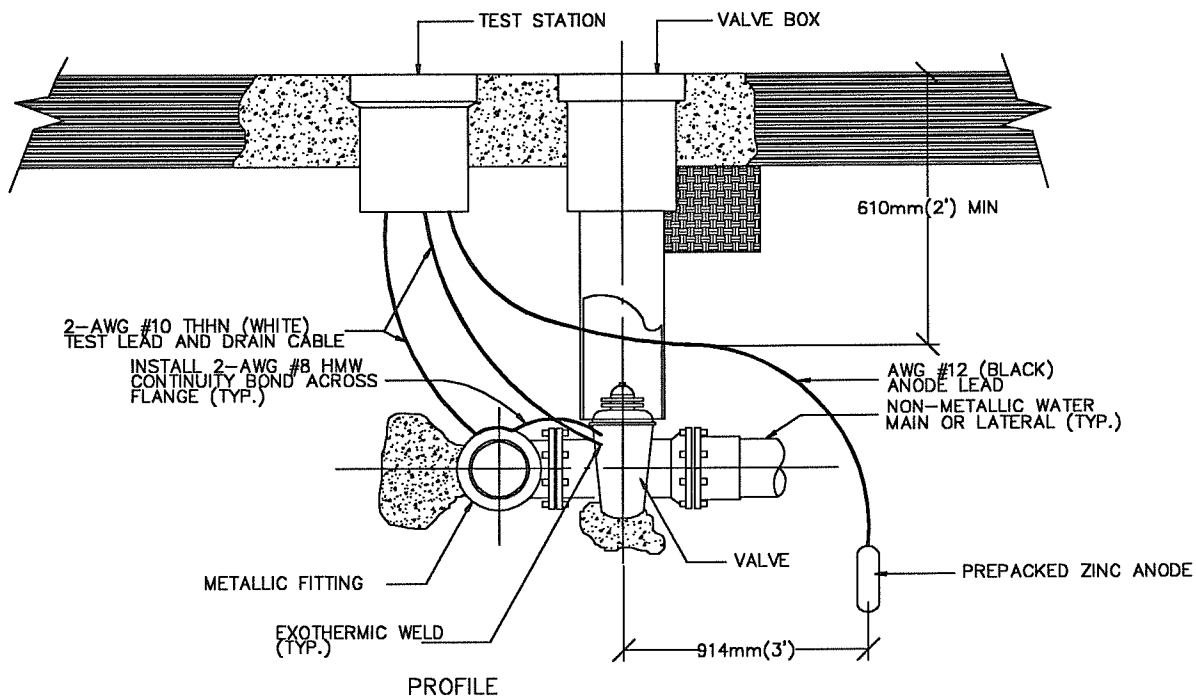


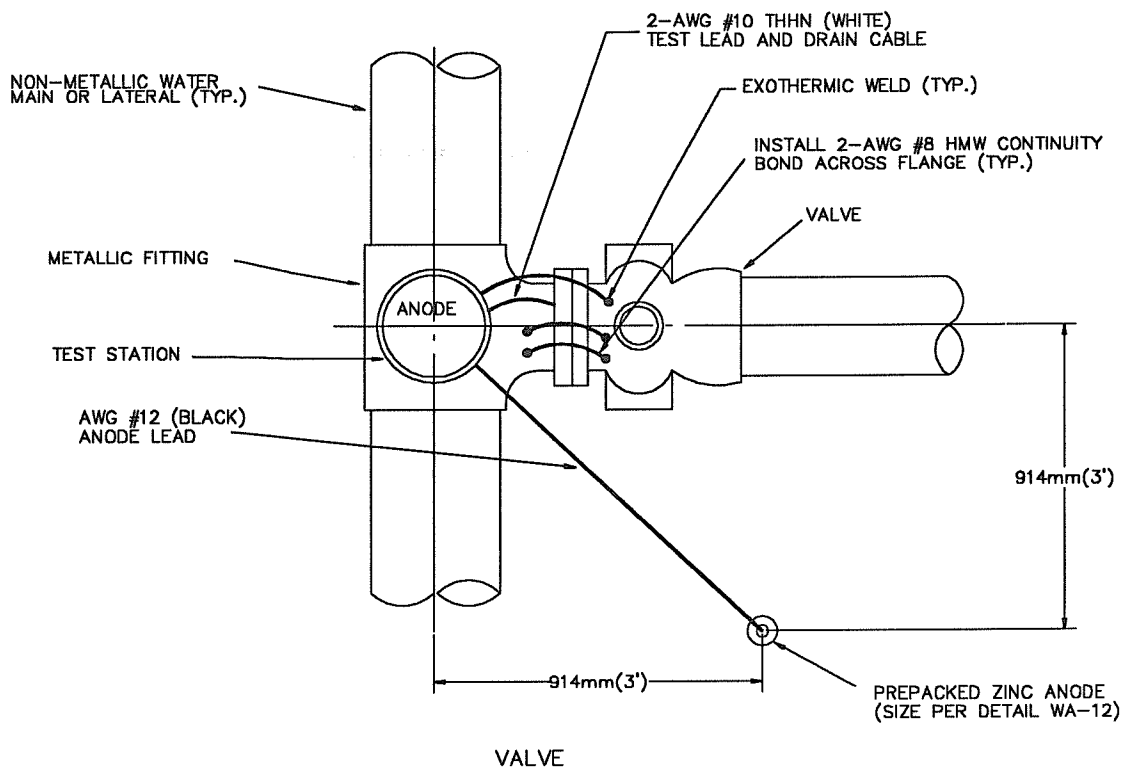

NOTE:

CONTRACTOR SHALL NOT BRING UP ANY CATHODIC PROTECTION. WIRES IN VALVE BOX

All units are in metric
Non-metric units are in brackets

ACAD FILENAME:CATPROT



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

CATHODIC PROTECTION AT FITTINGS & VALVES - (A)

APPROVED

Y. A. O...
Director of Engineering Services R.C.E. No.40998

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: **WA-7**