



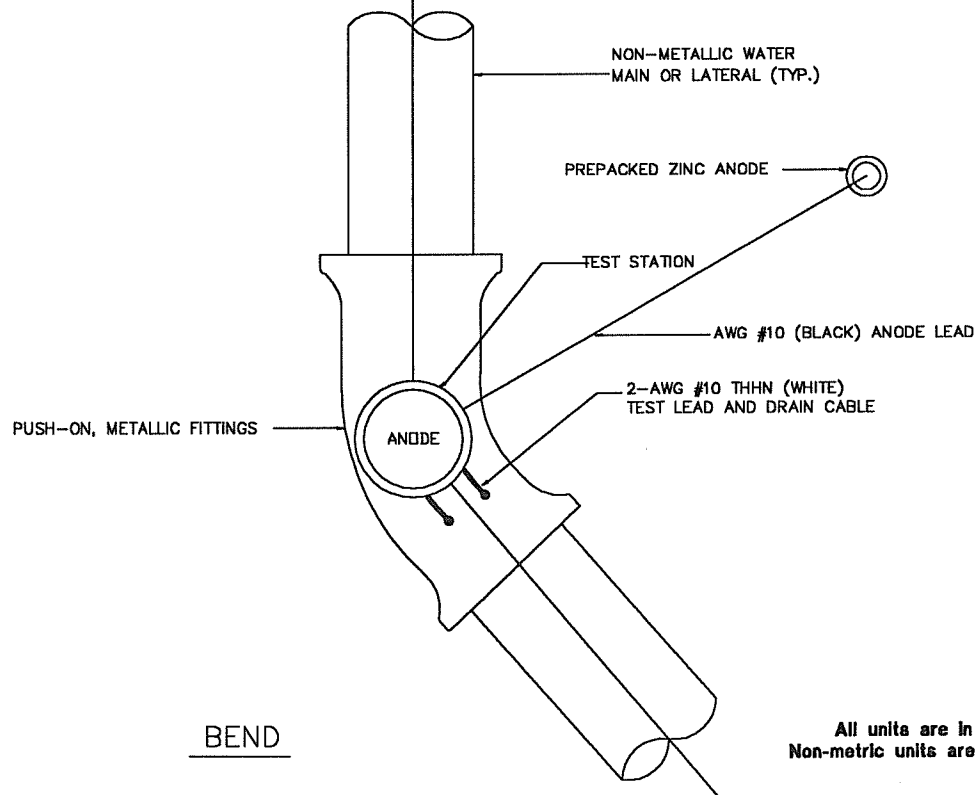

All units are in metric
Non-metric units are in brackets

ACAD FILENAME: CATPROT2

CITY OF MENLO PARK STANDARD DETAILS

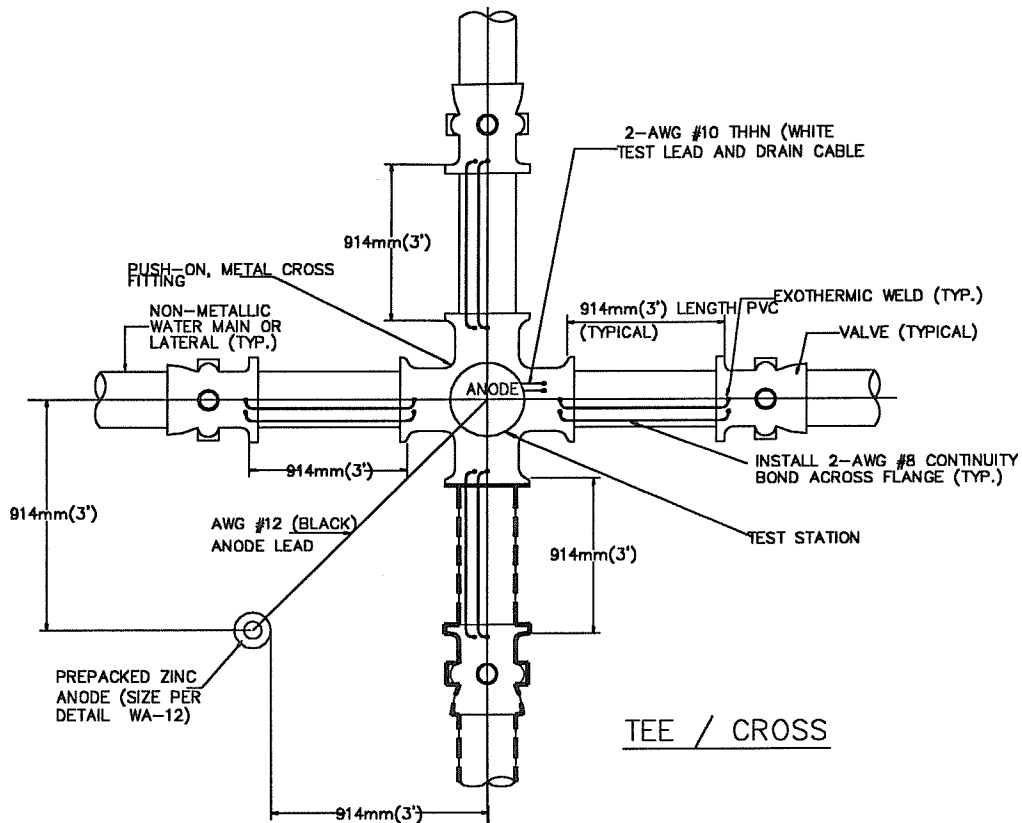

NO.	REVISIONS	DATE

CATHODIC PROTECTION AT FITTINGS & VALVES (B)

APPROVED

for *Lawrence A. Duran*
Director of Engineering Services R.C.E. No. 40998

DRAWN

CHECKED

NN

DATE 1-1-97

SCALE

NTS

SHEET 1 OF 1

STD. DETAIL No.: **WA-8**