


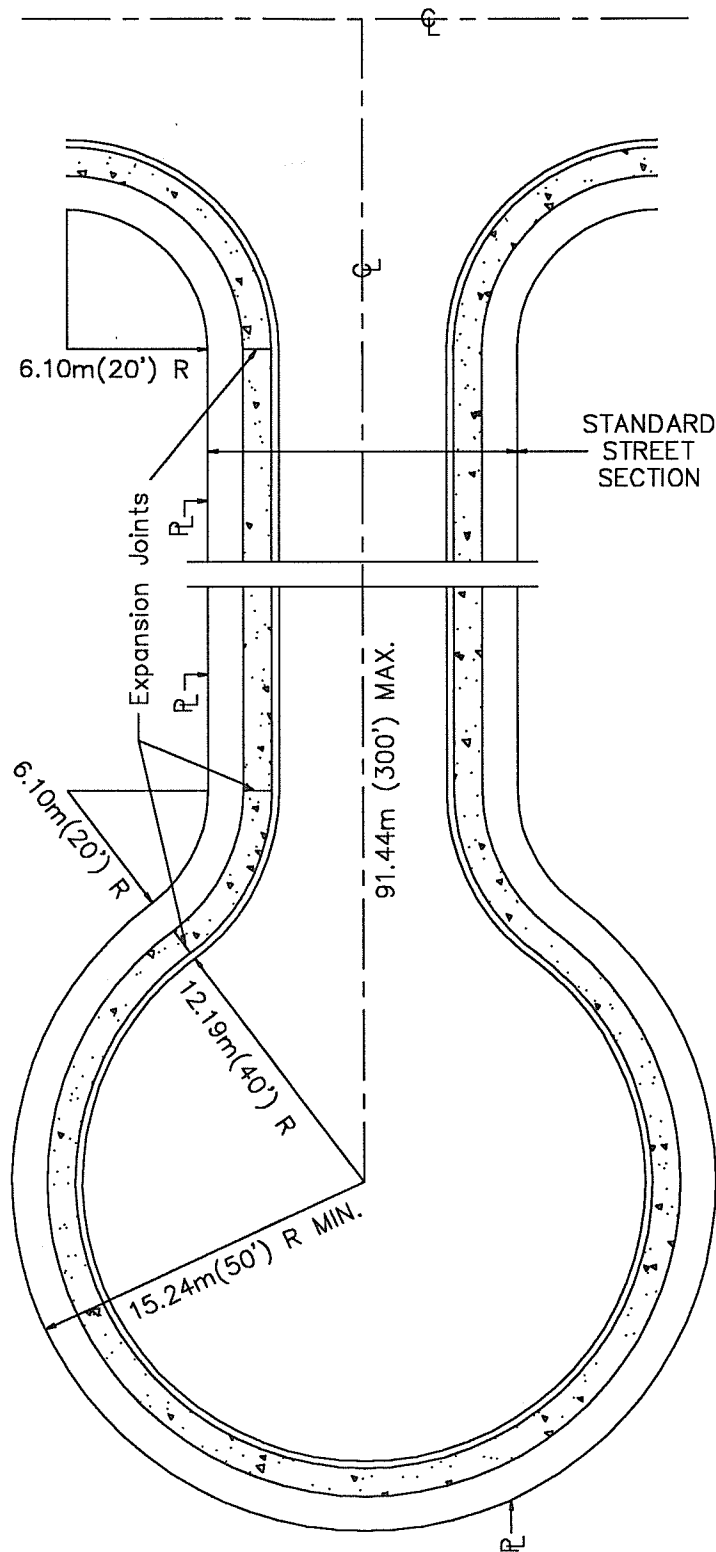

NOTES:

1. Commercial and industrial developments may require larger radii as determined by the City Engineer.
2. A longer street may be allowed to serve twelve or less lots.

**All units are in metric
Non-metric units in brackets**

ACAD FILENAME: CULDESAC



CITY OF MENLO PARK STANDARD DETAILS

NO.	REVISIONS	DATE

CUL - DE - SAC

APPROVED

Y. A. Ojeda
Director of Engineering Services R.C.E. No. 40998

DRAWN CHECKED NN DATE 1-1-97 SCALE NTS SHEET 1 OF 1

STD. DETAIL No.: **ST-2**